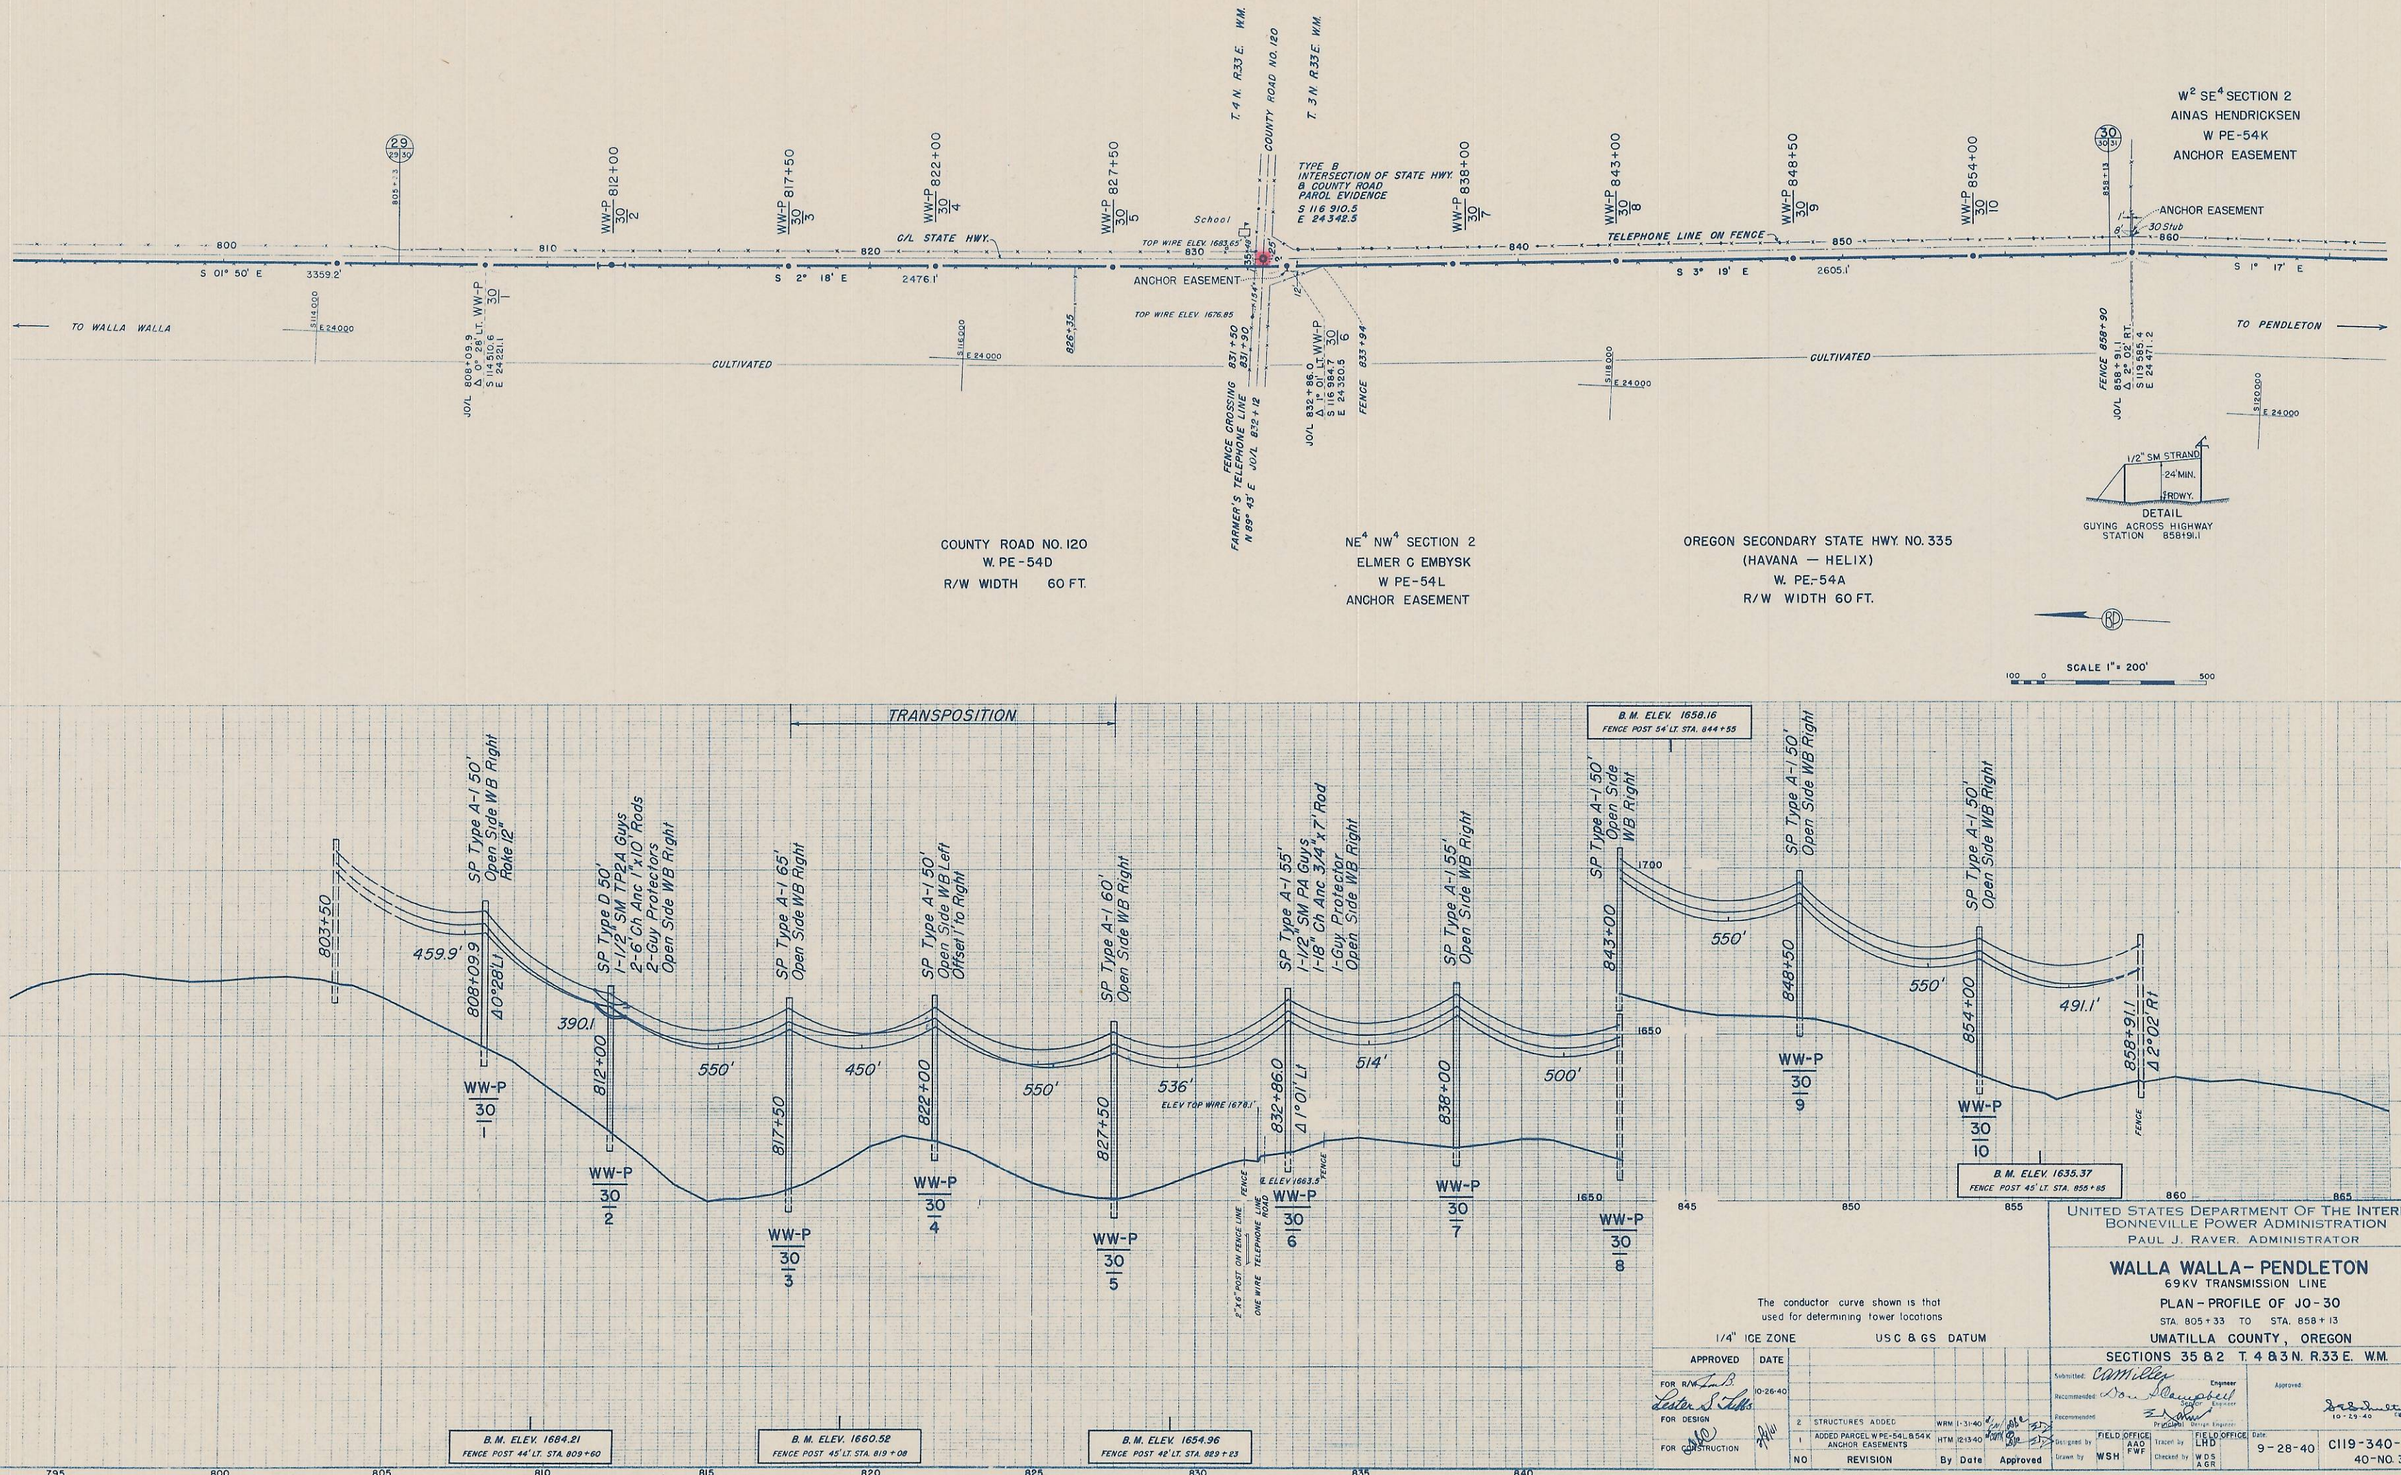

The conductor curve shown is that used for determining tower locations

1/4" ICE ZONE USC & GS DATUM

APPROVED	DATE
FOR R/W Lester D. Tibbs	10-26-40
FOR DESIGN	
FOR CONSTRUCTION	

NO	REVISION	By	Date	Approved
2	STRUCTURES ADDED	WRM	1-31-40	
1	ADDED PARCEL W PE-54L & 54K ANCHOR EASEMENTS	HTM	12-13-40	

UNITED STATES DEPARTMENT OF THE INTERIOR
BONNEVILLE POWER ADMINISTRATION
PAUL J. RAVER, ADMINISTRATOR

WALLA WALLA – PENDLETON
69KV TRANSMISSION LINE
PLAN – PROFILE OF JO-30
STA. 805+33 TO STA. 858+13
UMATILLA COUNTY, OREGON
SECTIONS 35 & 2 T. 4 & 3 N. R. 33 E. W.M.

Submitted: Cam Miller, Engineer
Recommended: Don Campbell, Senior Engineer
Recommended: Program Manager, Design Engineer
Approved: Dan Duncan, Chief Engineer, 10-29-40

Designed by	FIELD OFFICE AAO FWF	Traced by	FIELD OFFICE LHD	Date	CII9-340-DI
Drawn by WSH		Checked by WDS AGR		9-28-40	40-NO. 30

9630